

Engineering, Design and Construction Letter Agreement between Riverside Public Utilities Department and Southern California Edison Company

Riverside Public Utilities


City Council
March 13, 2018

RiversideCA.gov

BACKGROUND

The City of Riverside is served by Seven (7) 69kV Electric Transmission lines from Southern California Edison's Vista Substation located north of the City limits in Grand Terrace

SEVEN-69KV TRANSMISSION LINES SERVE RIVERSIDE

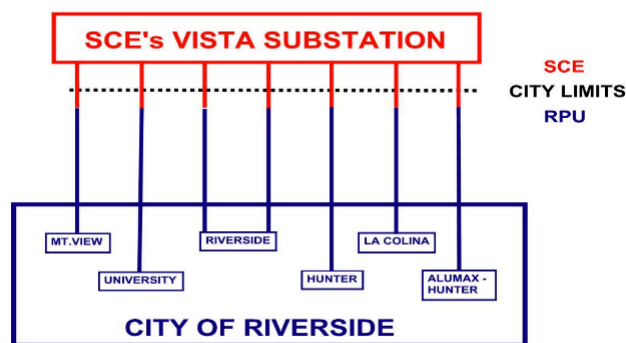

2

RiversideCA.gov

BACKGROUND

1. Metering Pulse totalizer failed on July 21, 2017
2. Installed around 1980
3. Equipment exceeded its useful design life



3



RiversideCA.gov

BACKGROUND (CONT.)

4. 66kV Metering Unit failed on August 19, 2017
5. Installed in the 1960s
6. Equipment exceeded its useful design life



66kV Metering PT - SCE Vista Substation

4



RiversideCA.gov

BACKGROUND (CONT.)

SCE and RPU Agree that the Replacement of the Pulse Totalizer, Failed Metering Unit and Acquisition of Spare Metering Units are Necessary for Accurate Measurement of the RPU Electric Demand and Reporting to the California Independent System Operator.




5

RiversideCA.gov

Project Description

1. Replace existing totalizer with a new totalizer
2. Perform complete testing and commissioning of the new totalizer

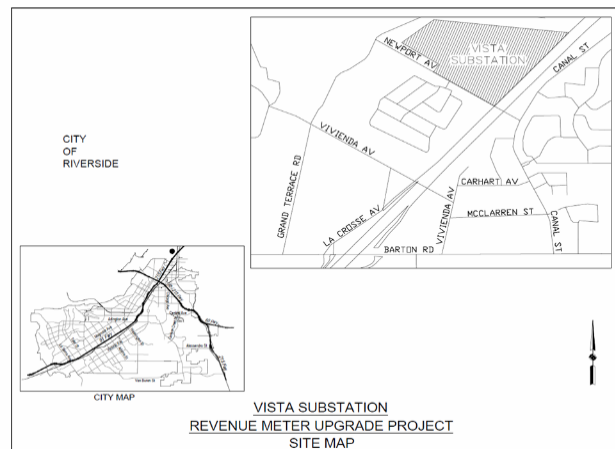


6

RiversideCA.gov

Project Description (CONT.)

3. Procure two (2) sets of 69kV metering units (one (1) set is spare)
4. Replace failed 69kV metering unit on Vista - Mountain View Line. Store spare set for use in event of future failure.

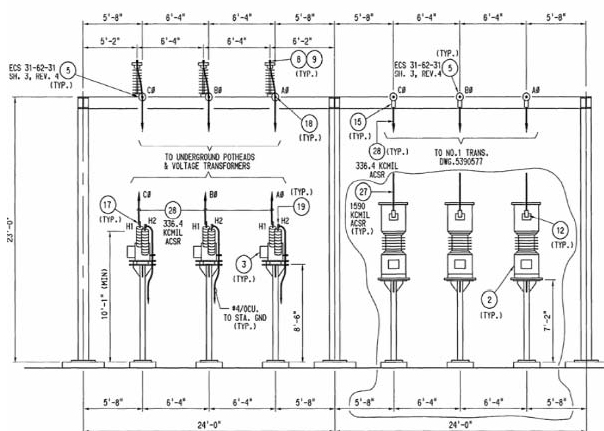

7



RiversideCA.gov

COST BREAKDOWN

DESCRIPTION	AMOUNT
SCE Estimated Cost – based on the Letter Agreement	\$782,757
Project Management and Engineering	\$36,000
RPU Testing and Commissioning	\$21,000
Contingency (5%)	\$41,988
Work Order Total	\$881,745

8



RiversideCA.gov

LONG TERM PLAN

1. RPU Engineering Staff Review to Replace the remaining Six (6) line Metering Units at Vista Substation.
2. Request Estimate to Replace the remaining Six (6) Metering Units at Vista Substation.
3. Review Budget Requirements and Return to Board for approval at a later date.



9

RiversideCA.gov

RECOMMENDATIONS

That the City Council:

1. Approve the Engineering, Design and Construction Letter Agreement with SCE for the work associated with existing metering pulse totalizer units and California Independent System Operator metering at Vista Substation in the amount of \$782,757.04; and



10

RiversideCA.gov

RECOMMENDATIONS (CONT.)

2. Authorize the City Manager, or his designee, to execute the Engineering, Design and Construction Letter Agreement with SCE, including making minor non-substantive changes, and to sign all documents necessary to complete the transaction for filing with the Federal Energy Regulatory Commission by SCE.

